
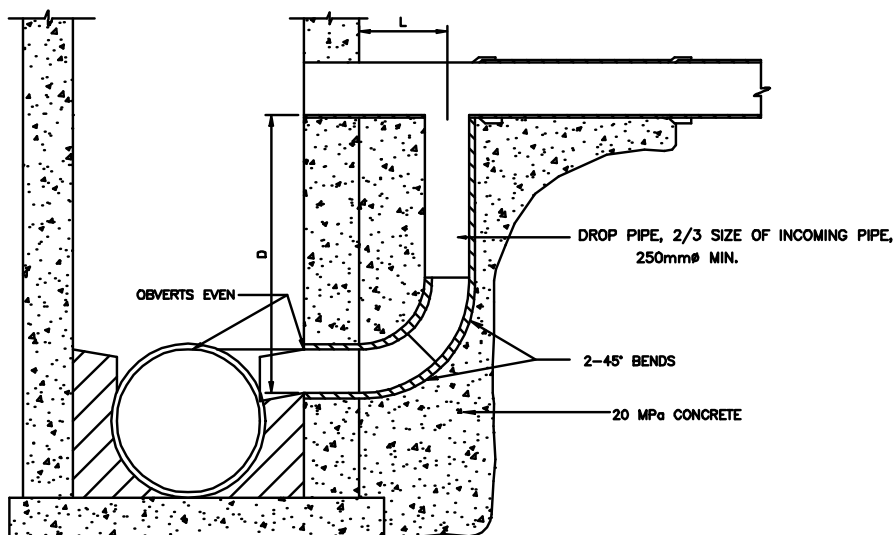


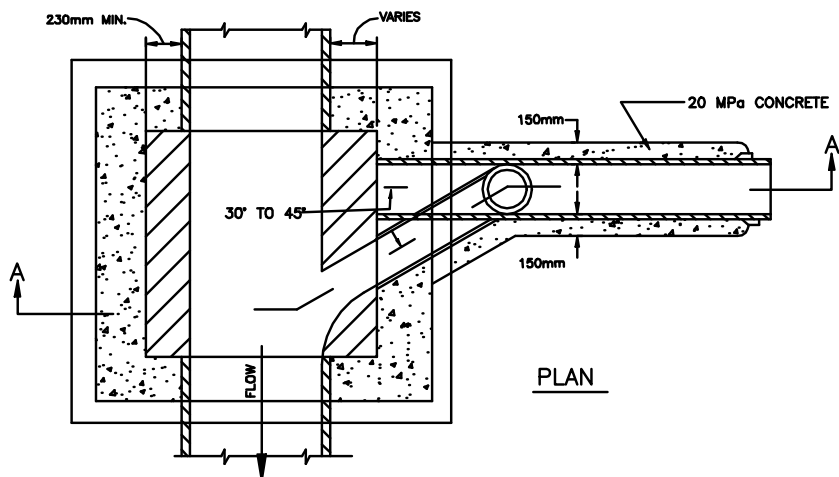

SECTION A-A

NOTES:

1. WHEN VALUE OF D IS LESS THAN D MIN. AS SHOWN IN THE TABLE, USE A 90° BEND OR LOWER INCOMING PIPE TO SUIT OUTLET.
2. DROP CONNECTION MUST BE USED WHEN DIFFERENCE IN INVERTS IS 900mm OR GREATER
3. ALL DIMENSIONS ARE IN MILLIMETRES OR METRES.
4. WHERE THE DIFFERENCE IN ELEVATION BETWEEN THE OBVERT OF THE INLET & OUTLET PIPES EXCEED 900mm, A DROP STRUCTURE SHALL BE PLACED ON THE INLET PIPE.

SIZE OF DROP PIPE mm	D MIN. mm	L MIN. mm
250 TO 450	900	600
525	1000	650
600	1100	700
675	1200	750
750	1300	800
825	1400	850
900	1500	900

APPROVED

REVISION

1

DATE OF REVISION
MARCH, 1989

TOWNSHIP OF UXBRIDGE

MANHOLE DROP CONNECTION
STORM SEWERS

DATE OF ISSUE
JANUARY 1980

DRAWING No.

US-130