


REINFORCED CONCRETE SUPPORT FOR HOUSE CONNECTIONS AND CATCH BASIN LEADS


WHEN WIDTH OF TRENCH EXCEEDS 1.52m BUT LESS THAN 3.05m

NOTE : WHEN WIDTH OF TRENCH EXCEEDS 3.05m METHOD OF SUPPORTING HOUSE CONNECTIONS AND CATCH BASIN LEADS, WILL BE AS DIRECTED BY THE FIELD ENGINEER.

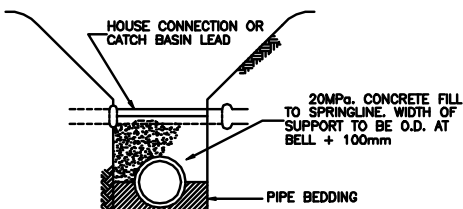

SUPPORT FOR CONNECTION CROSSING TRENCH

WHEN WIDTH OF TRENCH IS LESS THAN 1.52m

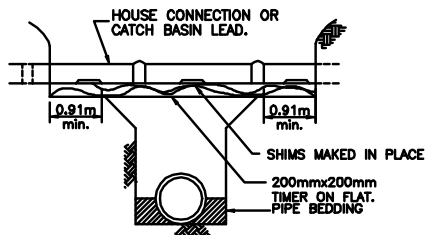

NOTES

1. WHERE HOUSE CONNECTIONS OR CATCH BASIN LEADS CROSS A SEWER TRENCH, THEY WILL BE SUPPORTED ON A NEW 200mm x 200mm TIMBER WHICH HAS A MINIMUM BEARING OF 0.91m AT EACH END. ON UNDISTURBED GROUND, CONNECTION MUST BE PROPERLY OR BEDDED ON 20MPa. CONCRETE FILL TO SPRINGLINE, AS PER DETAILS.
2. OPSP-1007.01 MAY BE USED WHEN APPROVED BY THE TOWNSHIP ENGINEER.
3. TO BE USED WHEN INSTALLING SEWER OR WATER MAIN ON EXISTING R.O.W.
4. ALL DIMENSIONS ARE IN METRES OR MILLIMETRES.
5. FOR ALL CROSSING OF GAS MAINS, CONTRACTOR TO CONTACT CONSUMER GAS FOR LOCATES & INSPECTIONS

APPROVED	TOWNSHIP OF UXBRIDGE	DATE OF ISSUE JANUARY 1980
REVISION 1	METHODS OF SUPPORTING HOUSE CONNECTIONS AND CATCH BASIN LEADS	DRAWING No. US-171
DATE OF REVISION MARCH, 1989		